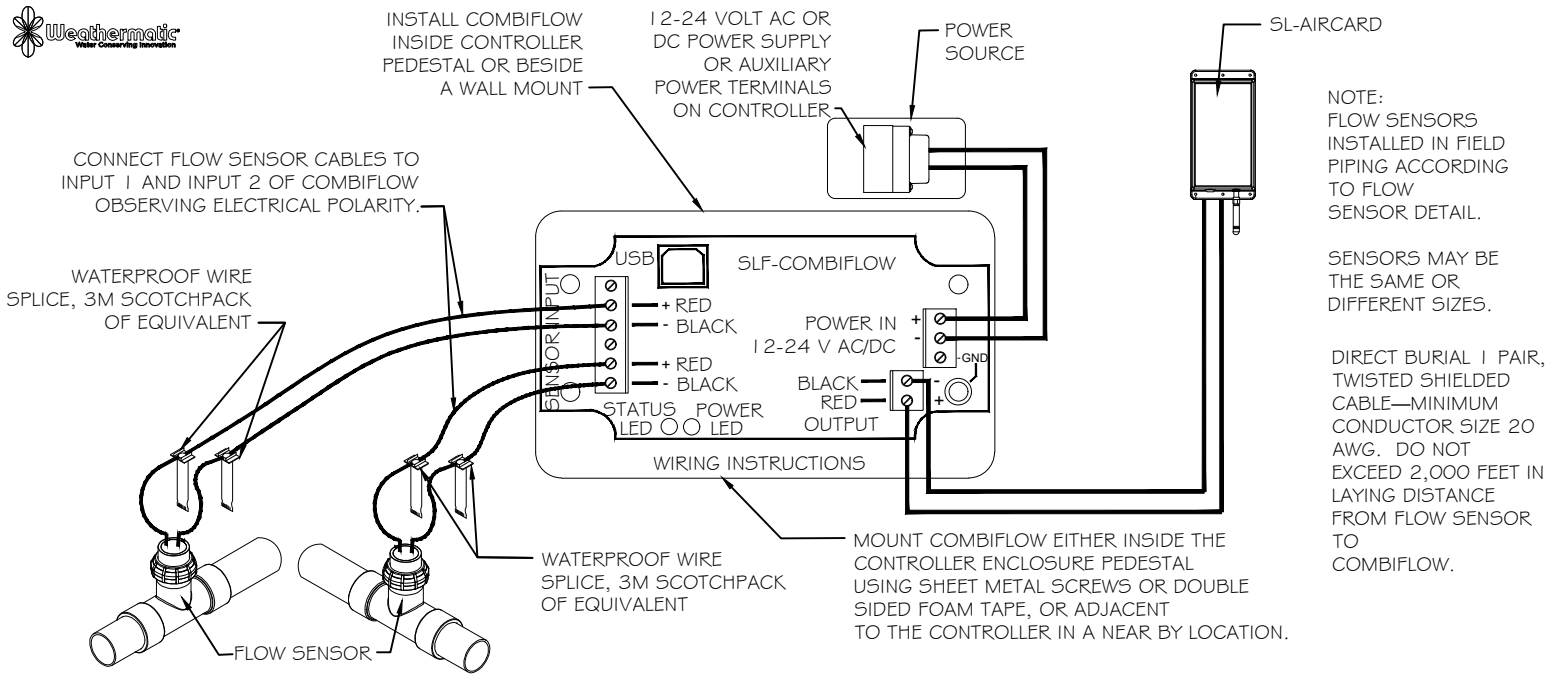

NOTE:
FLOW SENSORS INSTALLED IN FIELD PIPING ACCORDING TO FLOW SENSOR DETAIL.

SENSORS MAY BE THE SAME OR DIFFERENT SIZES.

DIRECT BURIAL 1 PAIR, TWISTED SHIELDED CABLE—MINIMUM CONDUCTOR SIZE 20 AWG. DO NOT EXCEED 2,000 FEET IN LAYING DISTANCE FROM FLOW SENSOR TO COMBIFLOW.

00 WEATHERMATIC SLF COMBIFLOW

NTS

DETAIL-FILE